

# Level Plus<sup>®</sup>

Magnetostrictive Liquid-Level Sensors  
with Temposonics<sup>®</sup> Technology



## Tank SLAYER<sup>®</sup> Application Data Sheet

Document Part Number  
551689 Revision A (EN) 08/2015

L	P	T			1		1															
1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	

To build the sensor model number in the fields provided above, download the product specification / data sheet from the following Tank Slayer<sup>®</sup> product page link and refer to the document's '**Ordering Information**':

<http://www.mtsensors.com/products/liquid-level-transmitters/TankSlayer/index.html>

### General Info

Company name:	Email address:
Quote number:	Country of final destination:
Customer name:	Phone number:
Project name:	Factory contact:

### Vessel Detail

Volume:	Height:
Diameter:	Material:
Lining:	Process connection type:
	Process connection size:

### Application Information

Maximum operating temperature:	Maximum operating pressure:
Vibration?: Yes No	Stilling well?: Yes No
Turbulence?: Yes No	Stilling well size:
Mixer?: Yes No	

#### Level 1

Process media:	Media specific gravity:
Viscosity:	Coating/buildup:

## Level 2

Process media:

Media specific gravity:

Viscosity:

Coating/buildup:

## Level Transmitter Specification

---

### Interface

Output signal  
(Check one):

Modbus

DDA

Process Variables

(Check all that apply): Product level

Interface level

Volume (Modbus output required)

Point temperature

Multipoint temperature (Modbus or DDA output required)

### Approval

Approval agency:

Method of protection:

Gas group:

Temperature code:

### Mechanical Packaging

Housing Style:

Material of  
construction:

Weight

Magnet


Hook

None

Order length:

Process connection size:

Process connection type:

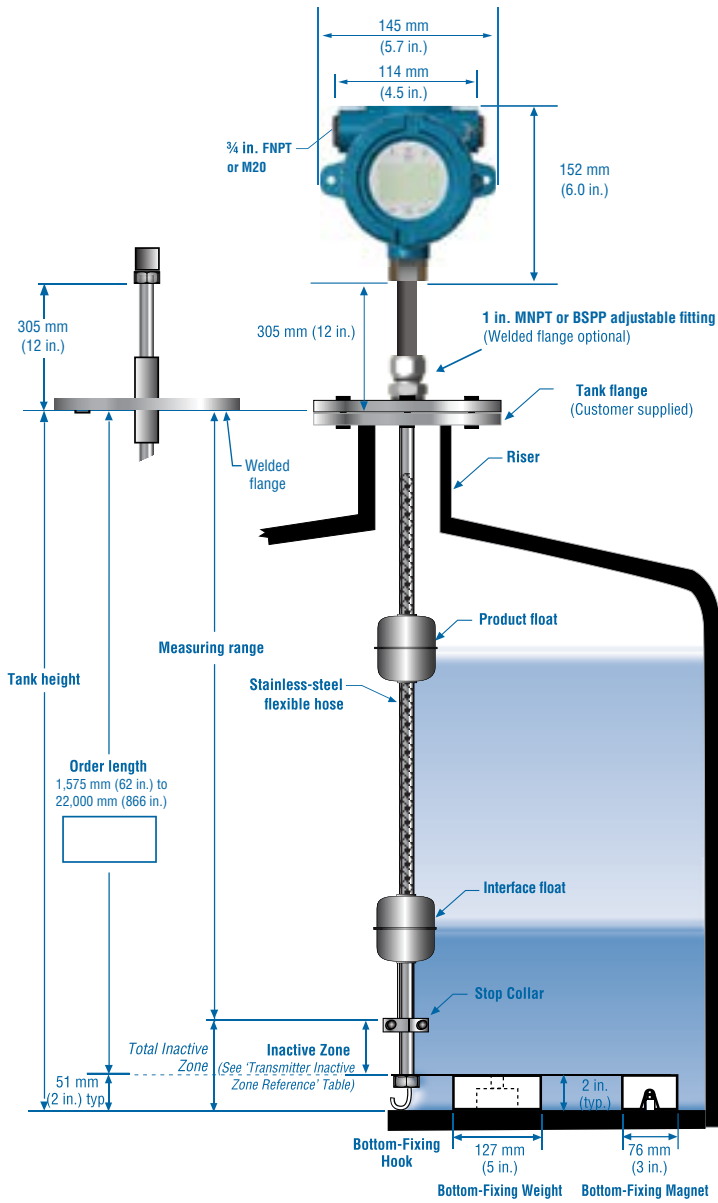

### General Ordering Notes:

1. For Inactive Zone from the tip of the transmitter, refer to the illustration, for details see table 'Transmitter Inactive Zone Reference'.
2. Allow overhead clearance for installation and removal of transmitter.

### Digital Ordering Notes:


1. DT 1 is 203 mm (8 in.) from the tip if length < 9144 mm (360 in.), 914 mm (36 in.) from tip if length ≥ 9144 mm (360 in.).
2. If you choose DT Placement Fixed, the first DT will be as described in Note 1 and the last DT will be at 80% of the order length. All other DTs will be evenly spaced.
3. If you choose DT Placement Custom, you must provide all DT locations in the Custom Temperature Position Table.

### Minimum order length

Number of DTs	Minimum order length
0	305 mm (12 in.)
1	305 mm (12 in.)
5	914 mm (36 in.)
12	2032 mm (80 in.)
16	2794 (110 in.)

### Transmitter inactive zone reference

Length	Inactive Zone
<7.6 m (25 ft.)	76 mm (3 in.)
7.6 m to 12.2 m (25 to 40 ft.)	97 mm (3.8 in.)
12.3 m to 22 m (40 to 72 ft.)	120 mm (4.7 in.)



### LEGAL NOTICES

**Document Part Number:**  
551689 Revision A (EN) 08/2015

MTS, Temposonics and Level Plus are registered trademarks of MTS Systems Corporation. All other trademarks are the property of their respective owners. Printed in USA. Copyright © 2015 MTS Systems Corporation. All Rights Reserved in all media.

All specifications are subject to change. Contact MTS for specifications and engineering drawings that are critical to your application. Drawings contained in this document are for reference only. Go to <http://www.mtssensors.com> for the latest product information.

### LOCATIONS

**USA**  
MTS Systems Corporation  
Sensors Division  
3001 Sheldon Drive  
Cary, N.C. 27513, USA  
Tel. +1-919-677-0100  
Fax +1-919-677-0200  
info.us@mtssensors.com  
www.mtssensors.com

**GERMANY**  
MTS Sensor Technologie  
GmbH & Co. KG  
Auf dem Schüffel 9  
58513 Lüdenscheid, Germany  
Tel. +49-23 51-95 87 0  
Fax +49-23 51-5 64 91  
info.de@mtssensors.com  
www.mtssensors.com

**JAPAN**  
MTS Sensors Technology Corp.  
737 Aihara-machi,  
Machida-shi,  
Tokyo 194-0211, Japan  
Tel. +81-42-775-3838  
Fax +81-42-775-5512  
info.jp@mtssensors.com  
www.mtssensors.com